




Product Name: CITY WLS

General information

- This luminaire must be installed in accordance with the latest edition of the IET Wiring Regulations and local Building Regulation by a qualified competent person.
- The mains power supply must be turned off before inspection, installation or removal of the luminaire, ensuring that the supply is locked off to prevent inadvertently switching the supply on.
- It is the installer's responsibility to ensure that the installation is suitable for the total load of the luminaire(s). The supply cable fuses/circuit breakers must be correctly rated for the electrical load and taking into account for any transient inrush currents that may occur.
- It is the installer's responsibility to ensure that the environmental operating and storage conditions are complied with and that any fire risks are considered.
- Do not perform insulation strength or insulation resistance tests on the installation with the luminaire(s) connected, this can damage the luminaires and give erroneous readings.
- Do not loop-in supply cables at the luminaire supply terminals unless there is provision for 2-way connection at the terminals.
- The light source contained in this luminaire must only be replaced by TamLite Lighting or an appointed service agent.
- Emergency lighting luminaires must be installed and maintained in accordance with the emergency lighting standard BS 5266-1.
- To ensure that the product warranty remains valid, the luminaire must be installed and maintained in accordance with these installation instructions and the product must not be modified in any way.

-  Luminaires marked with this symbol must not be covered with thermally insulating material.
-  This symbol on covers over light sources indicates dangerous live parts do not operate the luminaire with this cover removed.

Dimensions

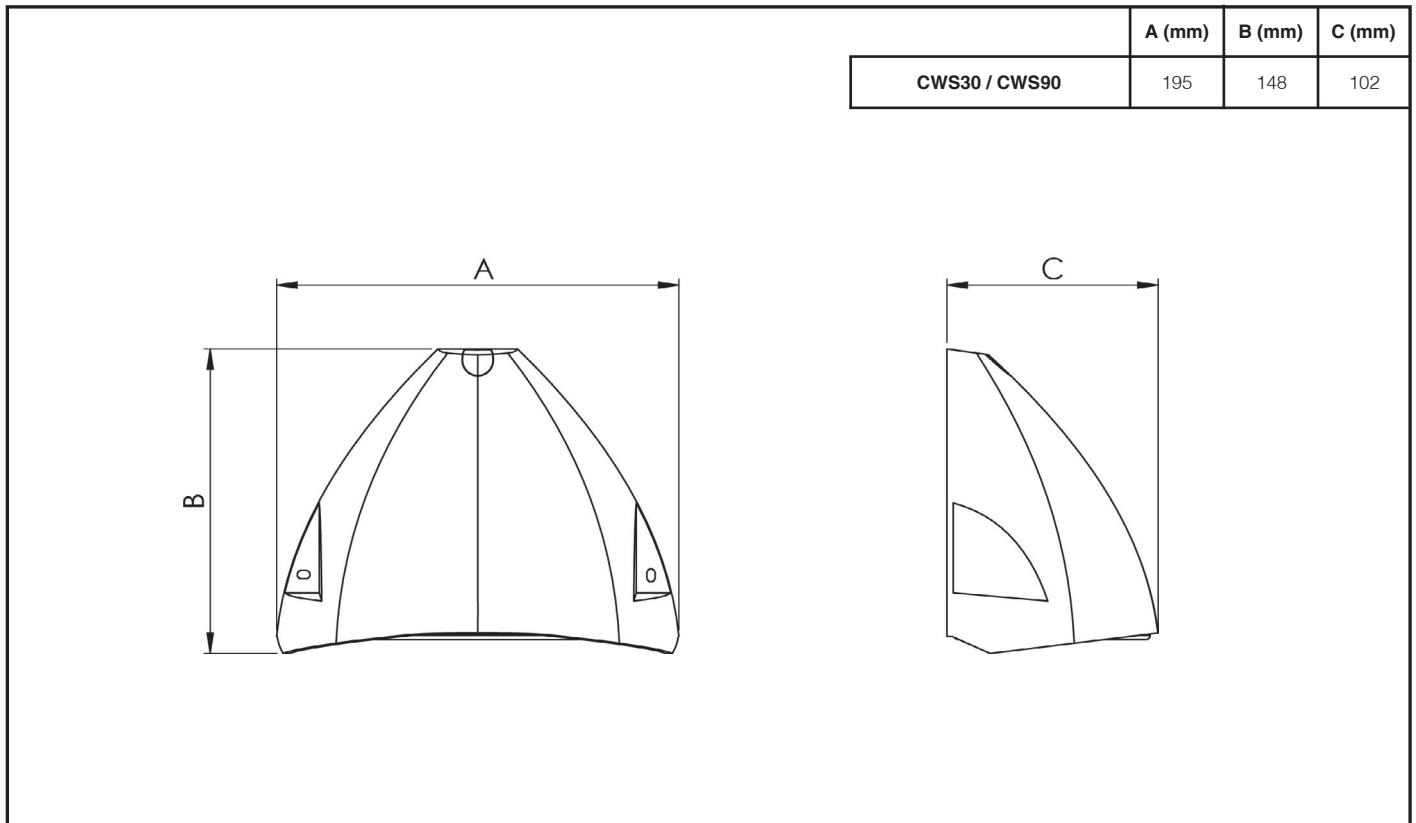

Product Name: CITY WLS

<p>1</p> <p>Remove the product from the packaging</p>	<p>2</p> <p>Remove the lighting unit and screw cap from the body.</p>
<p>3</p> <p>Bring the supply cable in to the body and prepare the mounting surface.</p>	<p>4</p> <p>Secure the body to the mounting surface with appropriate hardware.</p>
<p>5</p> <p>Connect the supply cable to the terminal block and secure with the cord grip.</p>	<p>6</p> <p>Terminations shown for standard and emergency variants.</p>
<p>7</p> <p>Terminations shown for DALI emergency variants.</p>	<p>8</p> <p>Replace the lighting unit and secure with the three screws.</p>

Page 2 of 2

Tamlite Technical
 Stafford Park 12,
 Telford, Shropshire,
 TF3 3BJ

+44(0)1952 292441
 technical@tamllite.co.uk
 Document No: V1

			220-240V 50/60Hz		IP65	IK10	ta 0°C to 25°C 5°C to 25°C for M3 variant
--	--	--	---------------------	--	------	------	--