

Product Name: 12V LED TAPE DRIVERS

General information

- This luminaire must be installed in accordance with the latest edition of the IET Wiring Regulations and local Building Regulation by a qualified competent person.
- The mains power supply must be turned off before inspection, installation or removal of the luminaire, ensuring that the supply is locked off to prevent inadvertently switching the supply on.
- It is the installer's responsibility to ensure that the installation is suitable for the total load of the luminaire(s). The supply cable fuses/circuit breakers must be correctly rated for the electrical load and taking into account for any transient inrush currents that may occur.
- It is the installer's responsibility to ensure that the environmental operating and storage conditions are complied with and that any fire risks are considered.
- Do not perform insulation strength or insulation resistance tests on the installation with the luminaire(s) connected, this can damage the luminaires and give erroneous readings.
- Do not loop-in supply cables at the luminaire supply terminals unless there is provision for 2-way connection at the terminals.
- The light source contained in this luminaire must only be replaced by TamLite Lighting or an appointed service agent.
- Emergency lighting luminaires must be installed and maintained in accordance with the emergency lighting standard BS 5266-1.
- To ensure that the product warranty remains valid, the luminaire must be installed and maintained in accordance with these installation instructions and the product must not be modified in any way.



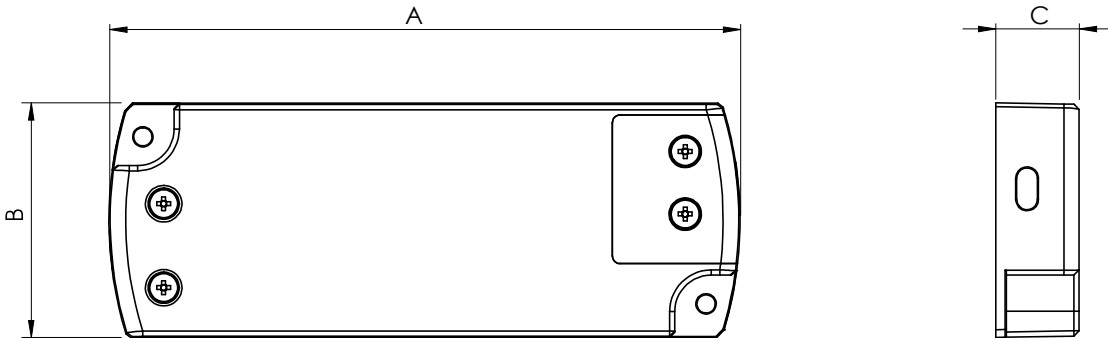
Luminaires marked with this symbol must not be covered with thermally insulating material.



This symbol on covers over light sources indicates dangerous live parts do not operate the luminaire with this cover removed.

Dimensions:

	A (mm)	B (mm)	C (mm)	Max. length of single run
FXDRV126	68	35	20	up to 1.2M
FXDRV1215	121	45	16	up to 3M
FXDRV1230	165	40	30	up to 6M
FXDRV1260	170	44	28	up to 8M

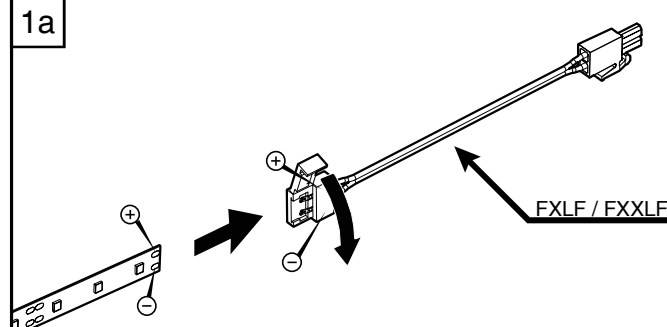
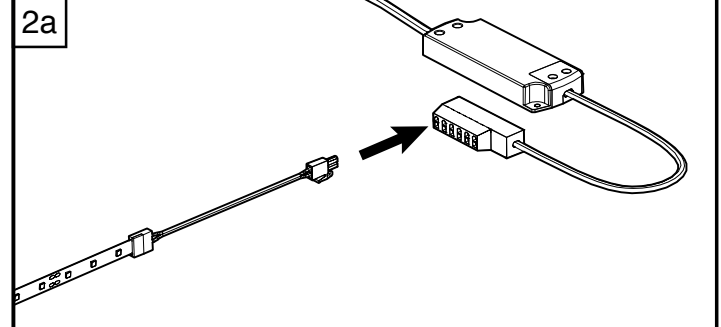
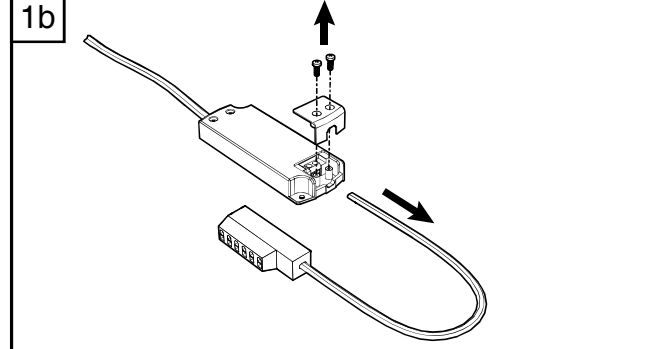
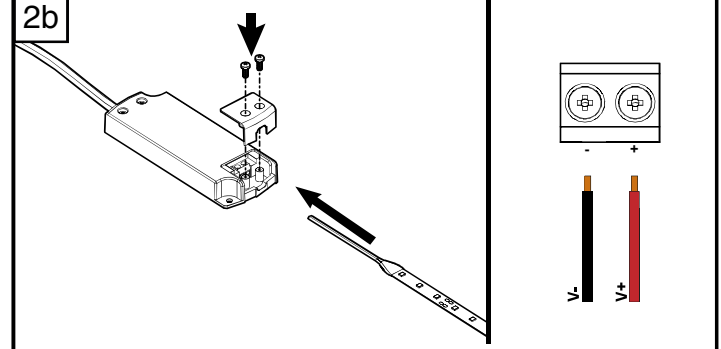
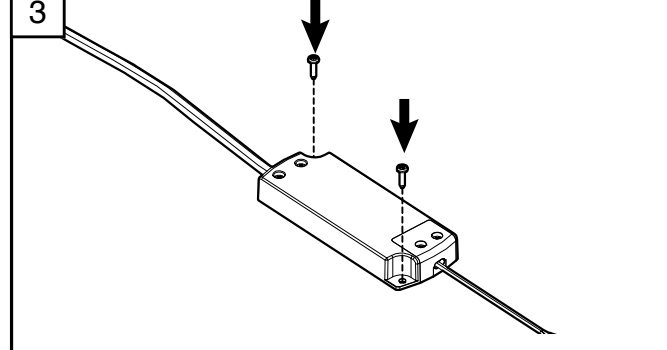
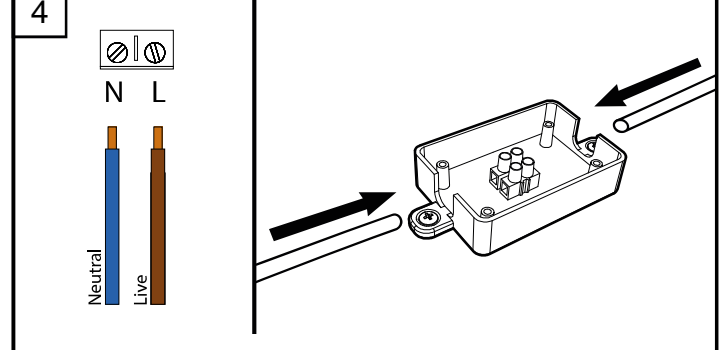


The technical drawing shows the physical dimensions of the FXDRV1260 LED tape driver. Dimension A represents the length of the unit, dimension B represents the width, and dimension C represents the height. The drawing includes a side view and a front view, with dimension lines indicating the specific measurements for each part.

INSTALLATION & OPERATING INSTRUCTIONS



Product Name: 12V LED TAPE DRIVERS

<p>1a</p>  <p>If using FXLF / FXXLF, connect to the tape and close the flap to secure.</p>	<p>2a</p>  <p>Connect up to 6 FXLF / FXXLF to the pre-connected AMP connector.</p>
<p>1b</p>  <p>If not using FXLF / FXXLF, remove the terminal cover and disconnect the AMP.</p>	<p>2b</p>  <p>Connect the pre-wired tape in to the driver terminals and replace terminal cover.</p>
<p>3</p>  <p>Secure the driver to the mounting surface.</p>	<p>4</p>  <p>Connect the mains supply with an appropriate terminal block.</p>

Page 2 of 2

Tamlite Technical
Stafford Park 12,
Telford, Shropshire,
TF3 3BJ

+44(0)1952 292441
technical@tamlite.co.uk
Document No: V1

