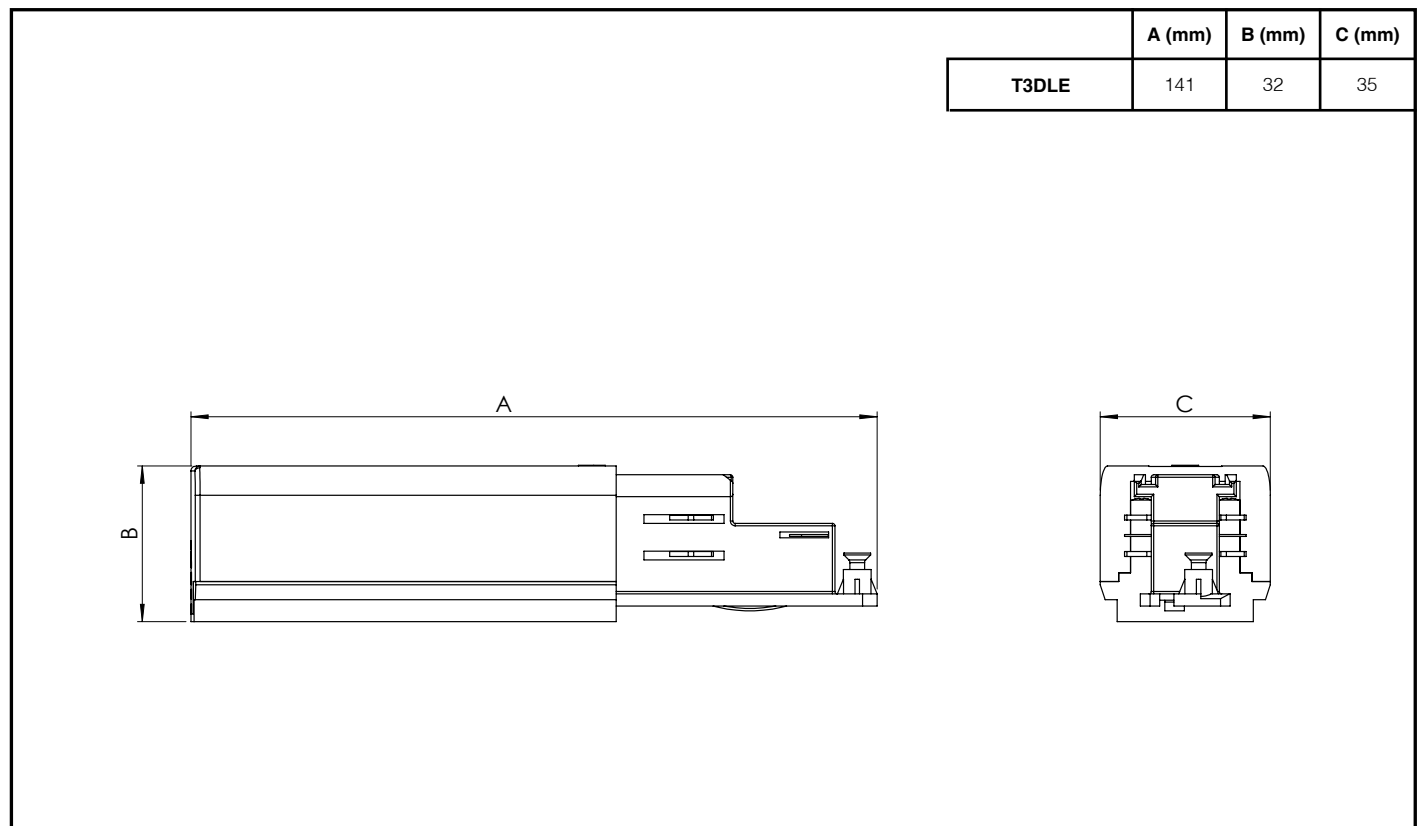


Product Name: TRIO TRACK LIVE END

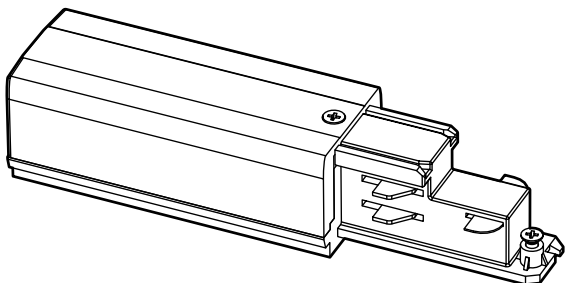
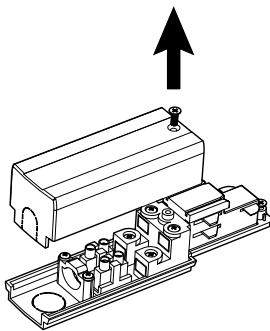
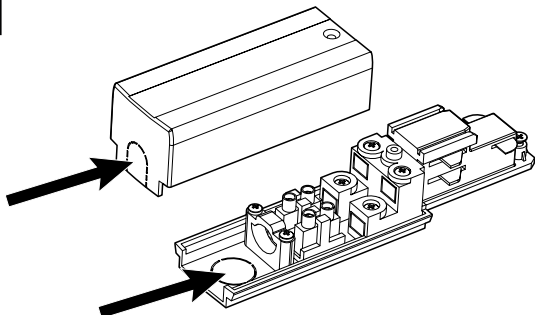
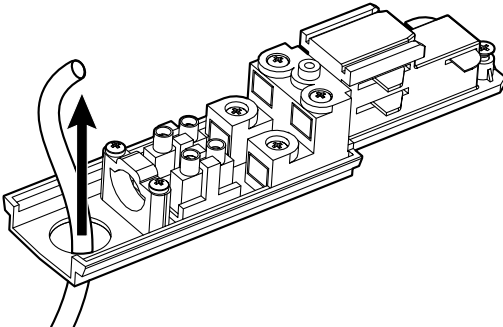
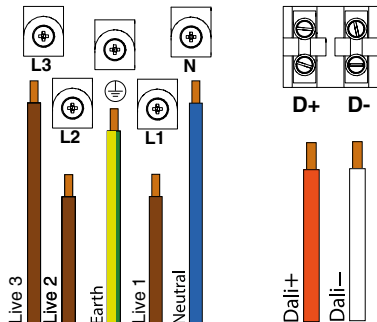
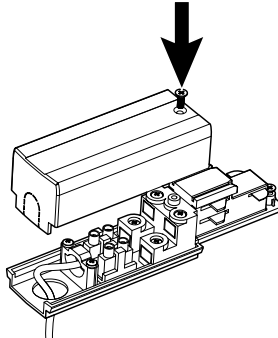
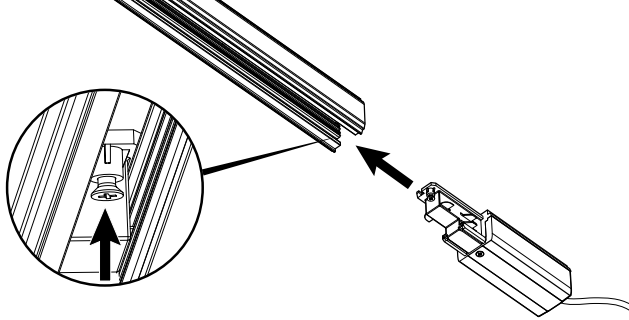
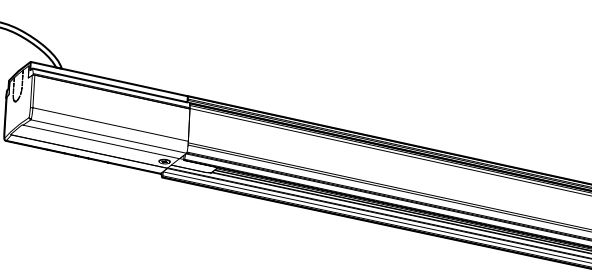
General information

- This product must be installed in accordance with the latest edition of the IET Wiring Regulations and local Building Regulation by a qualified competent person.
- The mains power supply must be turned off before inspection, installation, or removal of the product, ensuring that the supply is locked off to prevent inadvertently switching the supply on.
- It is the installer's responsibility to ensure that the environmental operating and storage conditions are complied with and that any fire risks are considered.
- To ensure that the product warranty remains valid, the track system must be installed and maintained in accordance with these installation instructions and the product must not be modified in any way.
- For use with Tamlite TRIO Track only.
- Connectors with alternative earth connections are available, please consult Tamlite Technical for further advise

Dimensions



Product Name: TRIO TRACK LIVE END

<p>1</p>  <p>Remove the product from its packaging.</p>	<p>2</p>  <p>Unscrew the top cover.</p>
<p>3</p>  <p>Break off the appropriate entry point.</p>	<p>4</p>  <p>If using the base entry point feed the supply cable through.</p>
<p>5</p>  <p>Terminate accordingly to the markings on the terminal</p>	<p>6</p>  <p>Replace the cover</p>
<p>7</p>  <p>Push the connector into the Trio Track Extrusion and tighten the screw to secure.</p>	<p>8</p> 

Page 2 of 2

Tamlite Technical
Stafford Park 12,
Telford, Shropshire,
TF3 3BJ

+44(0)1952 292441
technical@tamlite.co.uk
Document No: V1

